


Header Drawing Assembly

All Pipe & fittings 3/4" SCH80 PVC, with Exception of pH Entry Fitting which is 3/4" Stainless Steel with Ground Wire, Pre-plumbed, Sensors & Flowswitch Pre-wired

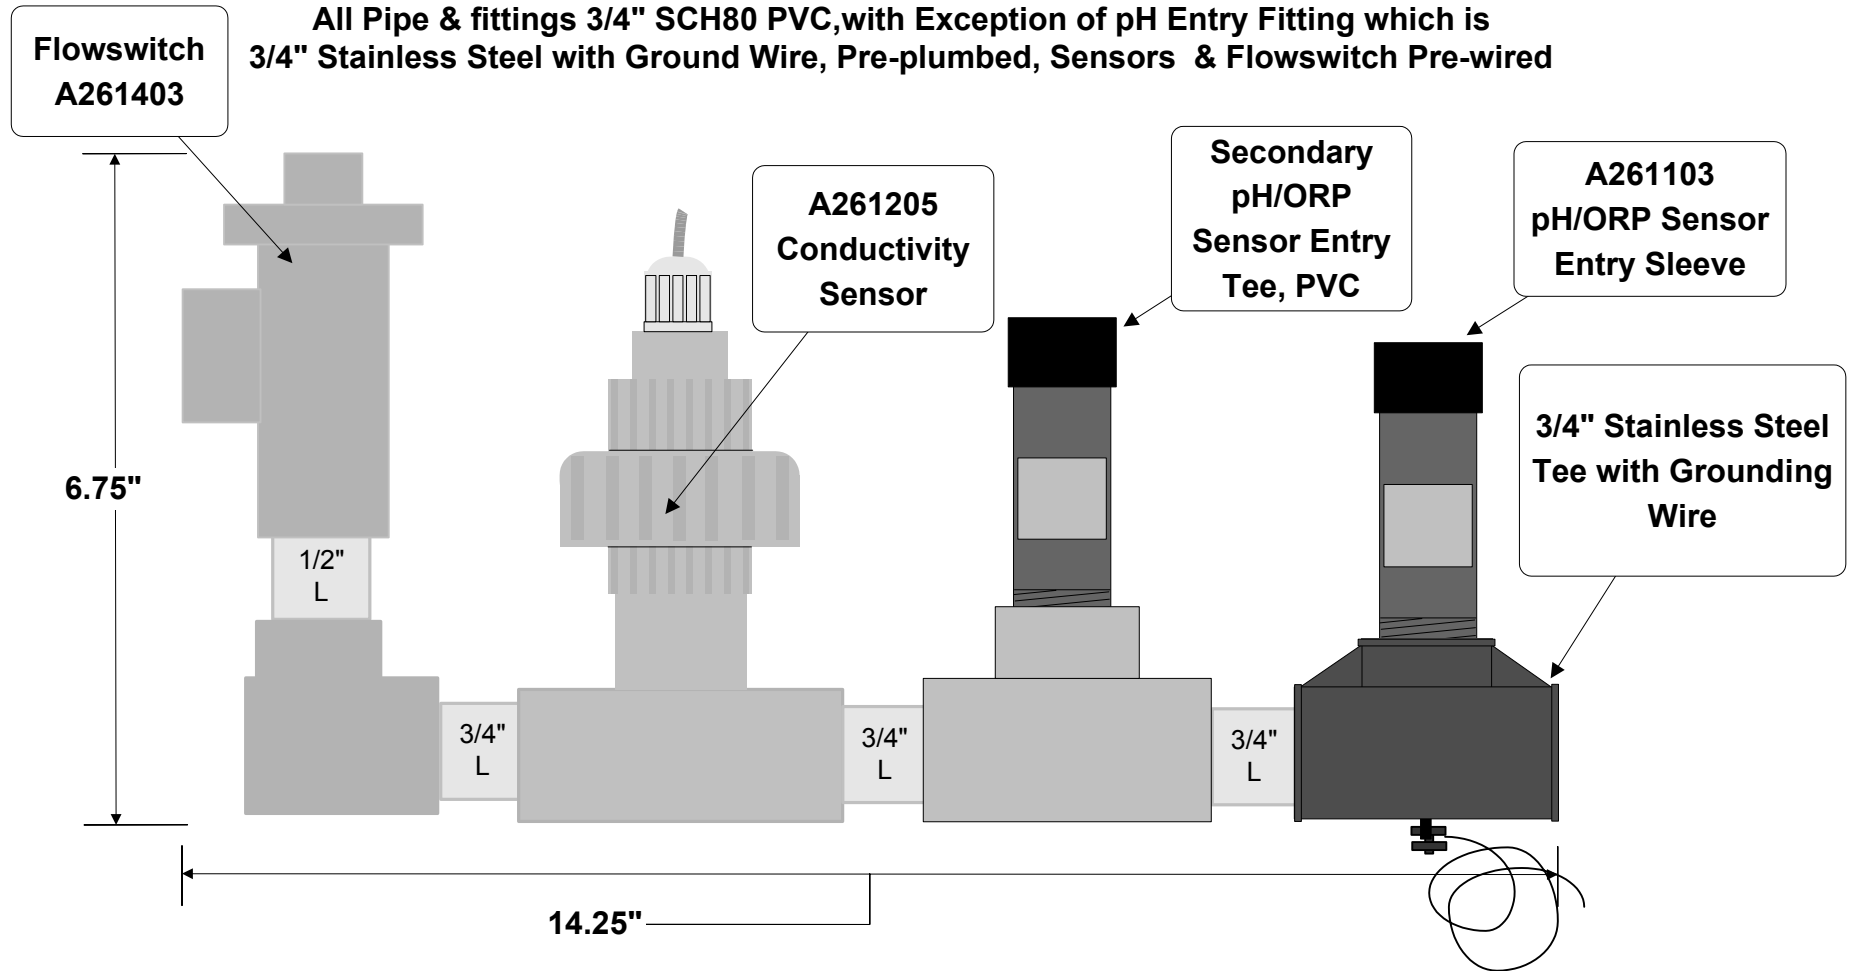

- 1) A261403 Magnetic Type Flow Switch
- 1) A261103 Sensor Insertion Sleeve with Cap
- 1) A261205 Conductivity Sensor and Tee
- 1) R381420 3/4" PVC Tee
- 1) R381460 4" x 3/4" PVC Nipple, cut in 1/2
- 2) ZPCN-SH 2" x 3/4" PVC Nipple
- 1) P9080T2 3/4" PVC Elbow
- 1) SXT-PHE 3/4" Stainless Steel Tee with Ground & Insertion Sleeve

<p>DRAWING TITLE</p> <p style="text-align: center; font-weight: bold; font-size: 1.2em;">HDR-CP-OR-F</p> <p>PROJECT TITLE</p>	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 20%;"></td> <td style="width: 10%;"></td> <td style="width: 20%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> </tr> <tr> <td>REFERENCE DRAWING</td> <td>NO.</td> <td>REVISION-LOCATION</td> <td>ECN</td> <td>DATE</td> <td>BY</td> </tr> <tr> <td colspan="3" style="text-align: center;">DRAWN</td> <td colspan="3" style="text-align: center;">APPROVED</td> </tr> <tr> <td>BY PAB</td> <td>DATE 03/24/06</td> <td>BY PAB</td> <td>DATE 03/27/06</td> <td colspan="2"></td> </tr> <tr> <td colspan="6" style="text-align: center;">Branch Information</td> </tr> <tr> <td colspan="3" style="text-align: center;"> <p style="font-weight: bold; font-size: 1.2em;">AQUATRAC™</p> <p>INSTRUMENTS, INC.</p> <p>SYSTEM DESIGN & ENGINEERING</p> </td> <td colspan="2"> <p>1957 Cedar Street Ontario, California 91761, U.S.A. 800.909.9283</p> </td> <td style="text-align: center; vertical-align: top;"> <p>PAGE 1 OF 1</p> <p>DRAWING NUMBER</p> <p style="font-weight: bold;">HDR-CP-OR-F.VSD</p> </td> </tr> </table>							REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	DRAWN			APPROVED			BY PAB	DATE 03/24/06	BY PAB	DATE 03/27/06			Branch Information						<p style="font-weight: bold; font-size: 1.2em;">AQUATRAC™</p> <p>INSTRUMENTS, INC.</p> <p>SYSTEM DESIGN & ENGINEERING</p>			<p>1957 Cedar Street Ontario, California 91761, U.S.A. 800.909.9283</p>		<p>PAGE 1 OF 1</p> <p>DRAWING NUMBER</p> <p style="font-weight: bold;">HDR-CP-OR-F.VSD</p>
REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY																																
DRAWN			APPROVED																																		
BY PAB	DATE 03/24/06	BY PAB	DATE 03/27/06																																		
Branch Information																																					
<p style="font-weight: bold; font-size: 1.2em;">AQUATRAC™</p> <p>INSTRUMENTS, INC.</p> <p>SYSTEM DESIGN & ENGINEERING</p>			<p>1957 Cedar Street Ontario, California 91761, U.S.A. 800.909.9283</p>		<p>PAGE 1 OF 1</p> <p>DRAWING NUMBER</p> <p style="font-weight: bold;">HDR-CP-OR-F.VSD</p>																																